

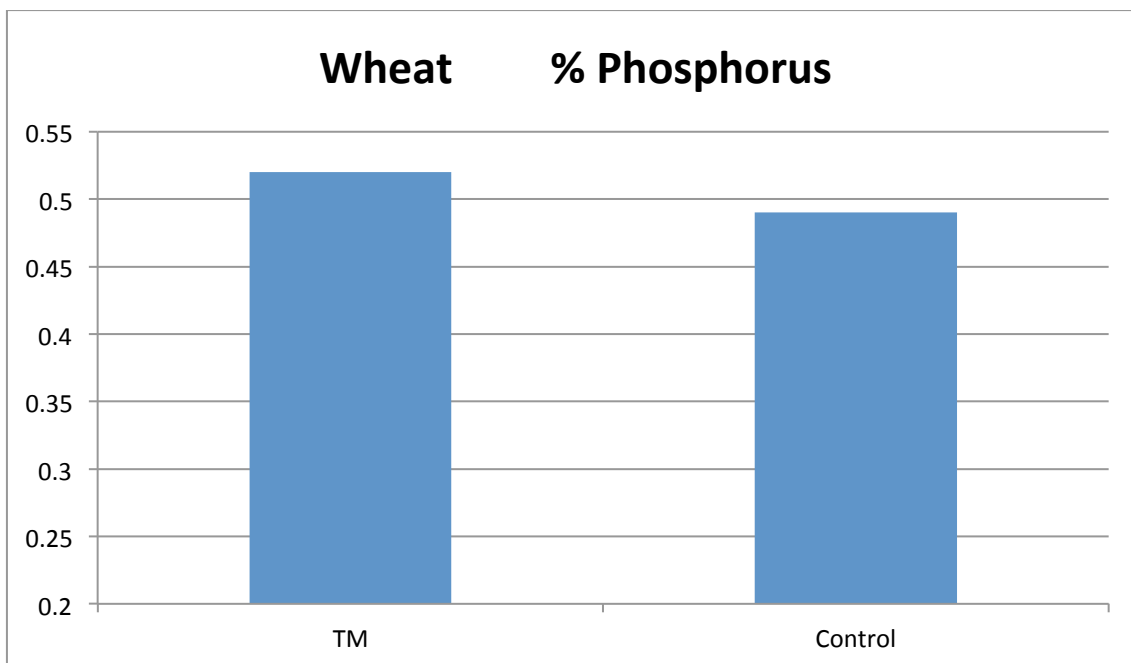
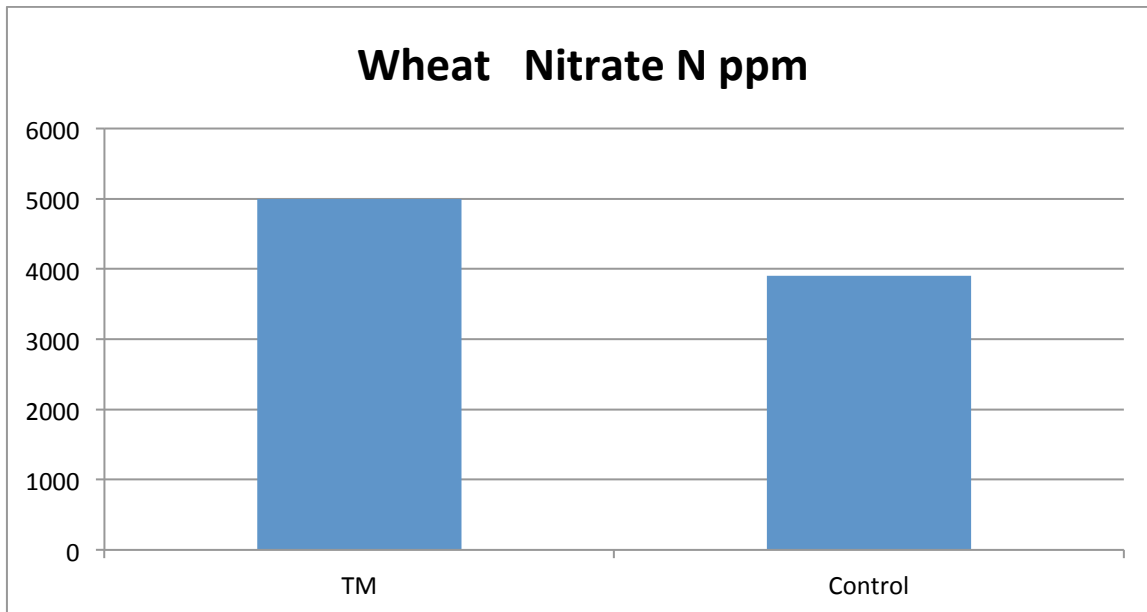
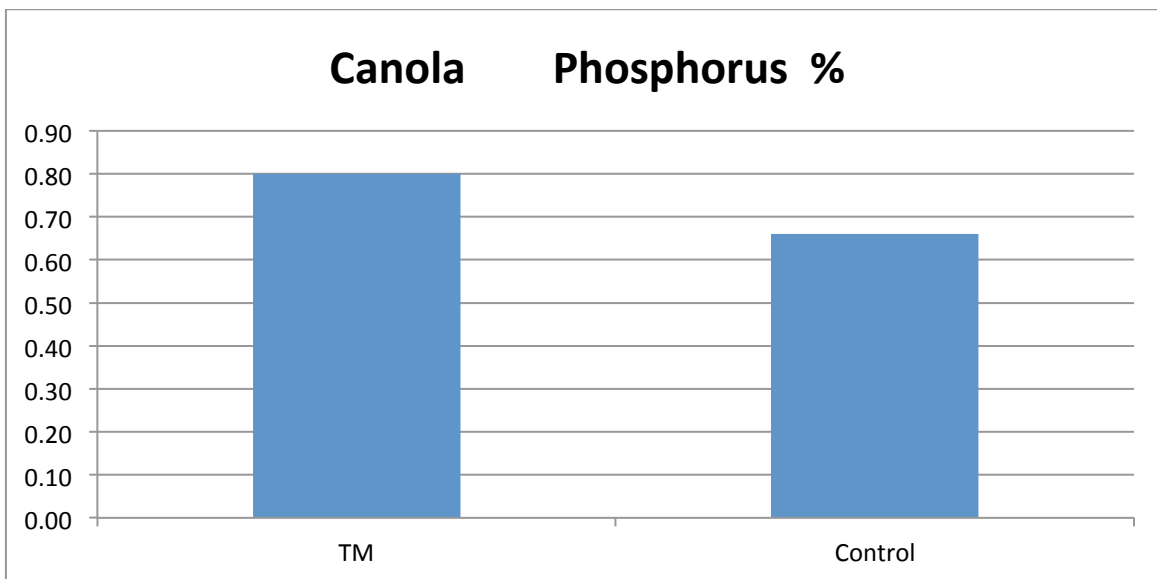



NPK Tissue Tests In Wheat and Canola, Horsham

All tests were carried out by Incitec Pivot Labs Melbourne, July

TM has been applied only once. The Control is zero application. All other inputs are the same
In each case the NPK concentrations are greater where the TM had been applied. This suggests better fertiliser efficiency with TM

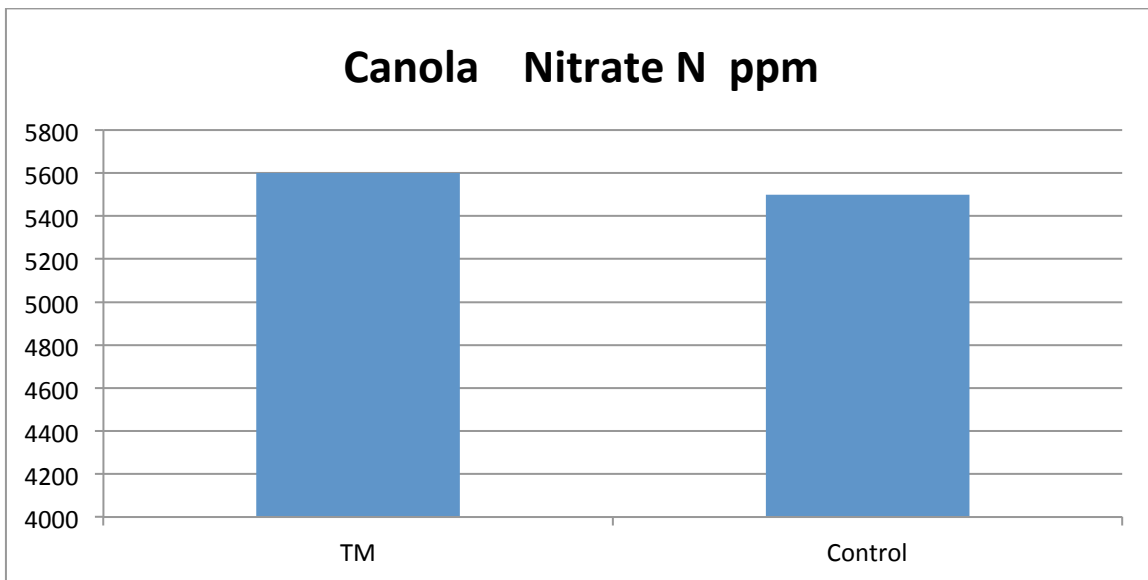

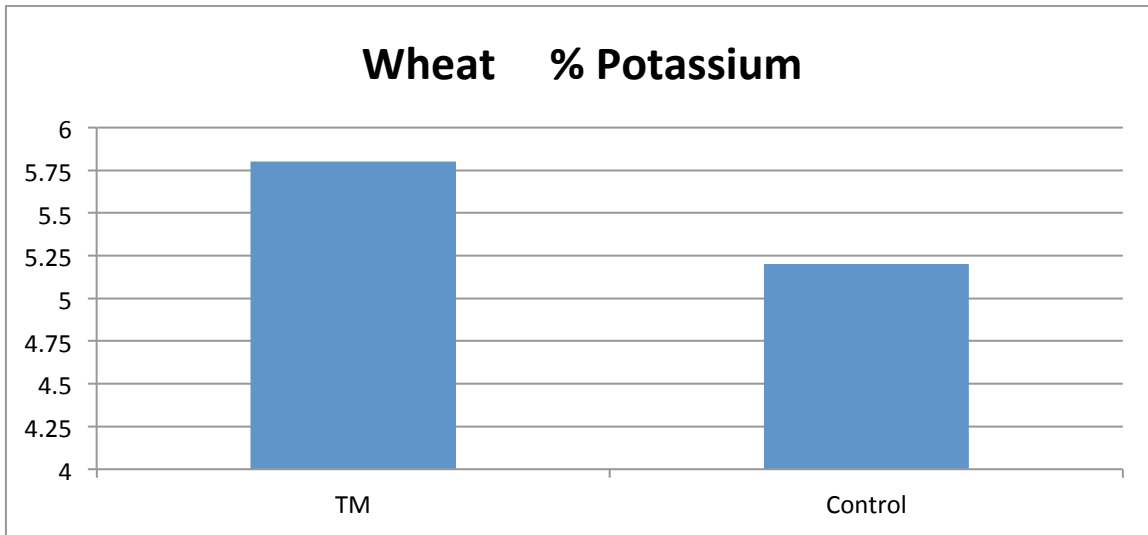

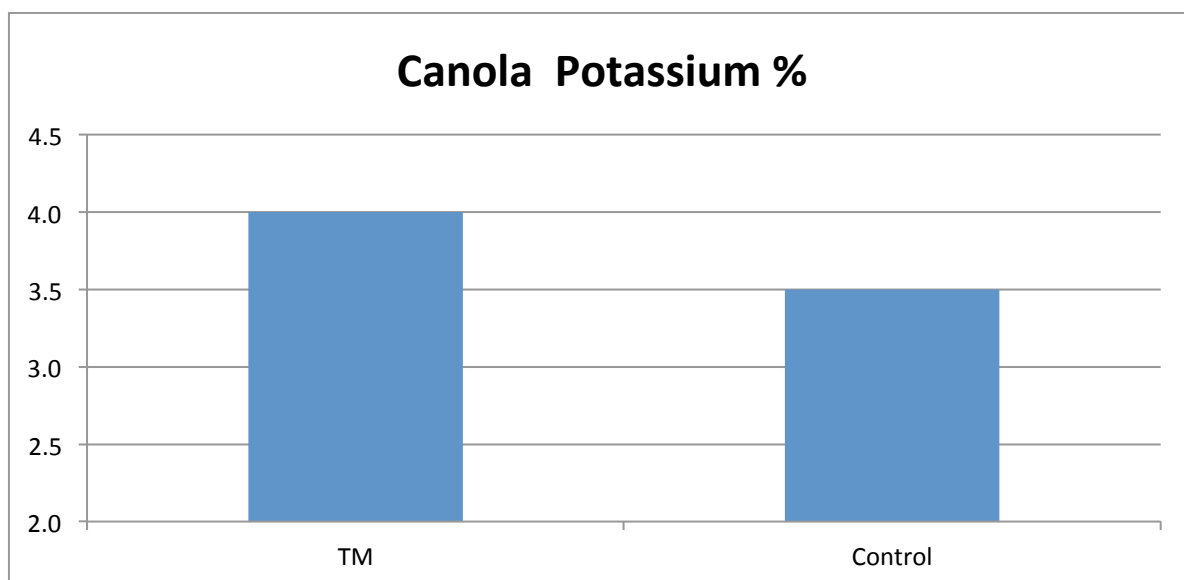

Barry Robinson
Agronomist
Robinson Rural Technology